


ALT.NO	ALT.DATE	ZONE	ALTERATIONS	AUTHORITY
a	02/02/2026	ALL	1.BOM UPDATED & DRAWING MODIFIED ACCORDINGLY.	CR NO. 230025001G

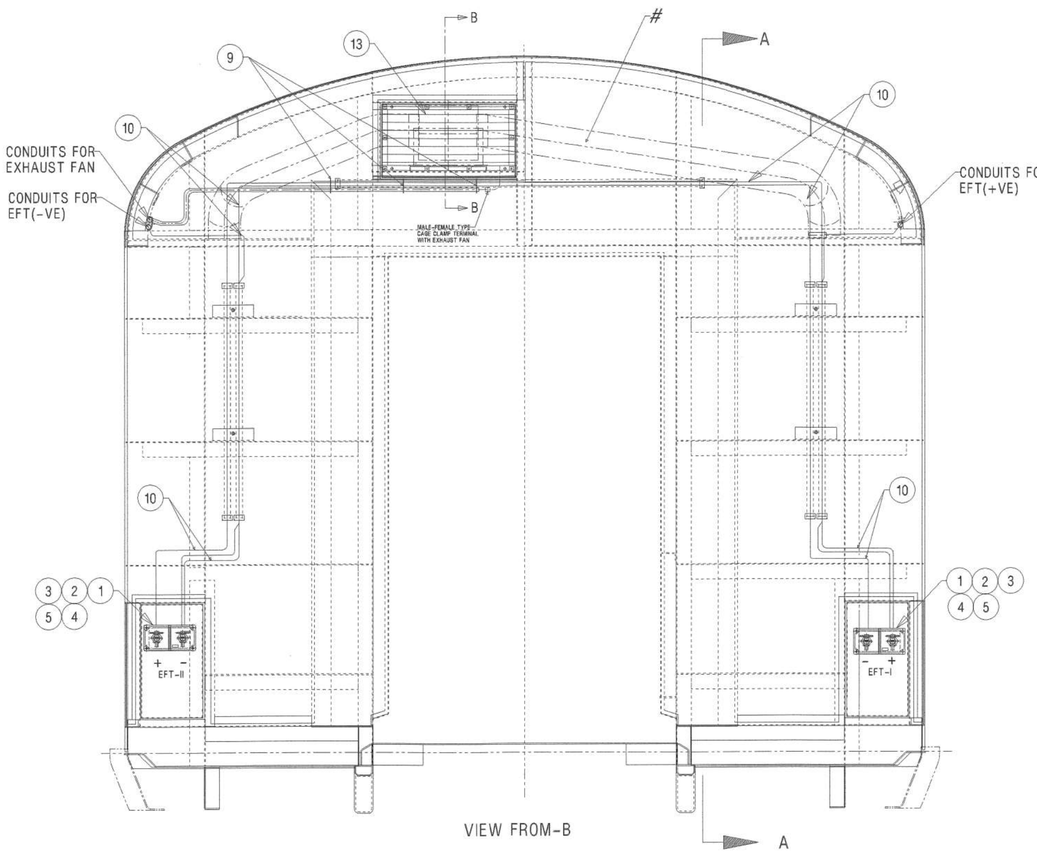


VIEW FROM-B

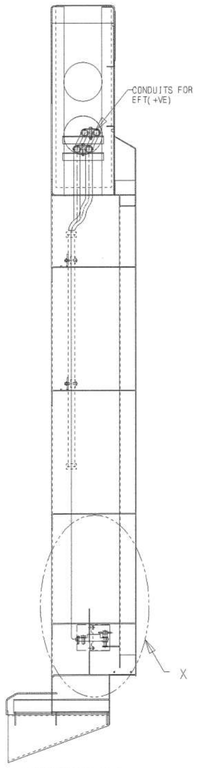

SECTION-AA

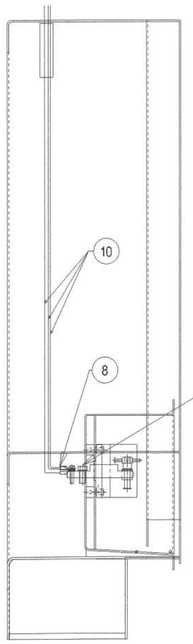


DETAIL AT -X

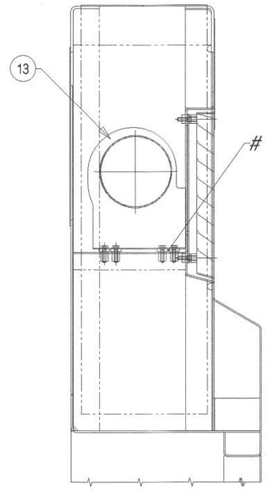

SECTION-BB

HARDWARE IN SCOPE OF EFT BOARD SUPPLIER CC75082, ALT-'b' OR LATEST.

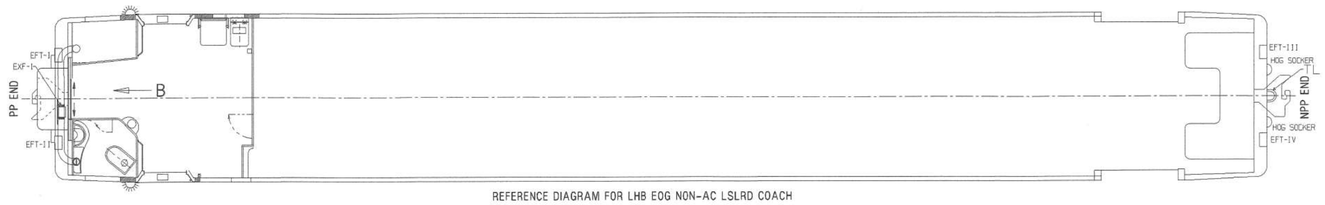

REFERENCE DIAGRAM FOR LHB EOG NON-AC LSLRD COACH

13	DOUBLE INLET CENTRIFUGAL BLOWER 190V AC,3-PHASE,50HZ,FOR EXHAUST FAN LAVATORIES	1	EDTS-432 REV-NIL	NIL	COR-1
12	4 SQ.MM BLUE THIN WALLED FLEXIBLE ELASTOMERIC CABLE WITH COPPER CONDUCTO UP TO 1100V(IN WTRS.)	48	ELRS/SPEC/ ELC/0019,	NIL	REV-4
11	4 SQ.MM RED THIN WALLED FLEXIBLE ELASTOMERIC CABLE WITH COPPER CONDUCTO UP TO 1100V(IN WTRS.)	48	ELRS/SPEC/ ELC/0019,	NIL	REV-4
10	CABLE JACKET	10	EDTS-138, CORR-1	NIL	ITEM-5
9	CABLE BINDER	30	CC76129 NIL	NIL	ITEM-1
8	COPER CRIMPING SOCKET FOR 4 SQ.MM E-BEAM COPPER CABLE	6	EDTS-201 REV-A,AM-2	NIL	ITEM-8 FOR EFT
7	HEXAGONAL NUT M6,GALVD.	6	IS: 1363(P3) -92.5	NIL	NIL
6	HEXAGONAL HEAD SCREW M6X20,GALVD.	4	IS: 1363(P2) -92,4.6	NIL	FOR BLOWER CLAMP
5	PLAIN WASHER 6.6,GALVD	8	IS: 2016-67, T-2,TY-A	NIL	FOR EFT CLAMP
4	SPRING WASHER M6,GALVD.	8	IS: 3063-94, TY-B	NIL	FOR EFT CLAMP
3	HEXAGONAL HEAD SCREW M6X35,GALVD	8	IS: 1363(P2) -92,4.6	NIL	FOR EFT BOARD
2	RUBBER PACKING FOR EMERGENCY FEED TERMINAL	2	SCNLR-7-5-0 NIL	NIL	NIL
1	EMERGENCY FEED TERMINAL BOARD	2	CC75082 OR LATEST	NIL	NIL

ITEM	DESCRIPTION & DIMENSIONS	QPASSLY	DETAIL DRG	MATL. & SPEC.	REMARKS

#6.EXHAUST FAN MOUNTING ARRANGEMENT FOR LAVATORIES TO DRAWING NO.LW64236,(LATEST).
5.CABLE JACKET SHALL BE SECURED WITH CABLE BINDER (ITEM NO-9) ON BOTH ENDS TO PREVENT SLIDING OF CABLE JACKET OVER THE CABLES.
4.REFER TO CODE OF PRACTICE FOR WIRING FOR 110V DC TRAIN LIGTING FOR EL/TL/48,(REV-1)-2005.
3.REFER TO FERRULE NUMBER FOR EFT WIRING TO EDTS-410,REV-NIL,COR-1,AM-1&2 OR LATEST.
2.THERE SHALL BE NO GAP BETWEEN EFT TERMINAL BOARD AND END-WALL,THE SAME SHALL BE SEALED WITH SIKA FLEX, IF REQD FOR ANY GAP OBSERVED.
1.EFT-I,II,II & IV SHALL BE SCREEN PRINTED ON END-WALL AS SHOWN IN DRAWING NO.CC83177 & CC83187,ALT-NIL.
NOTE:-

THIS DRAWING IS THE INTELLECTUAL PROPERTY OF RAIL COACH FACTORY, KAPURTHALA. THIS DRAWING SHOULD NOT BE REPRODUCED,ALTERED, USED FOR MANUFACTURING OF COMPONENTS, SOLD OR TRANSFERRED WITHOUT PERMISSION FROM CHIEF DESIGN ENGINEER. RAIL COACH FACTORY, KAPURTHALA.

WELD LENGTH	NIL M	GROUP	ELECTRICAL
WEIGHT	NIL KG	FILE	Z:\LR75007a.prt
S.AREA	NIL M²	SUPERSEDES:	LR75007 ALT a
~~LENGTH/DIA~~	NIL M		
WIDTH/THICK.	NIL M		
HEIGHT	NIL M		

ARRG.OF END WALL WIRING ON PP END (110V DC TL SYSTEM)

(LHB HOG COMPLIANT LHB EOG NON-AC LSLRD (31 SEATER) COACH)

RAIL COACH FACTORY, KAPURTHALA

SCALE	SSE/ED
	CHD
	DRN

REF.DRG.No. NIL

रेल कोच फैक्टरी कपूरथला | IRS

Blmd SEE/VD | DY.CEE/D

PL NO.	NIL
DRG.NO.	LR75007
ALT.	a
SIZE	A1
SHEET	1/1

ANY MANUAL ALTERATION SHALL AUTOMATICALLY RENDER THIS DRAWING INVALID.

FOR UNTOLERANCED DIMENSIONS REFER MDG0008

DETAIL DRGS STARTING WITH "LI" ARE INTERNAL REFERENCE LISTS ONLY AND ARE NOT FOR ISSUE.

DATE OF FIRST ISSUE 30/01/2019